

New Zealand Sports Turf Institute

Laboratory Analysis Test Results

Sample Details


Origin of Sample: McCallum Bros
 Sample Name: Links 707
 Date Received: 28.7.21
 Date Tested: 28.7.21

Particle Size Distribution - Dry Sieved

Category	Diameter (mm)	Dry Weight (g)	Percent in Category
Coarse Gravel	4.0-8.0	0.0	0.0
Fine Gravel	2.0-4.0	0.0	0.0
V. Coarse Sand	1.0-2.0	0.1	0.1
Coarse Sand	0.5-1.0	8.9	4.4
Medium Sand	0.25-0.5	140.0	69.7
Fine Sand	0.125-0.25	50.4	25.1
V. Fine Sand	0.063-0.125	1.3	0.7
Silt and Clay	<0.063	0.1	0.1
Total		200.8	100.0

Result

Sieve Size	Percent Passing	Specification (min - max)
8.000	100.0	100
4.000	100.0	100
2.000	100.0	100
1.000	99.9	100
0.500	95.5	90 - 100
0.250	25.8	0 - 40
0.125	0.7	0 - 3
0.063	0.1	0 - 1

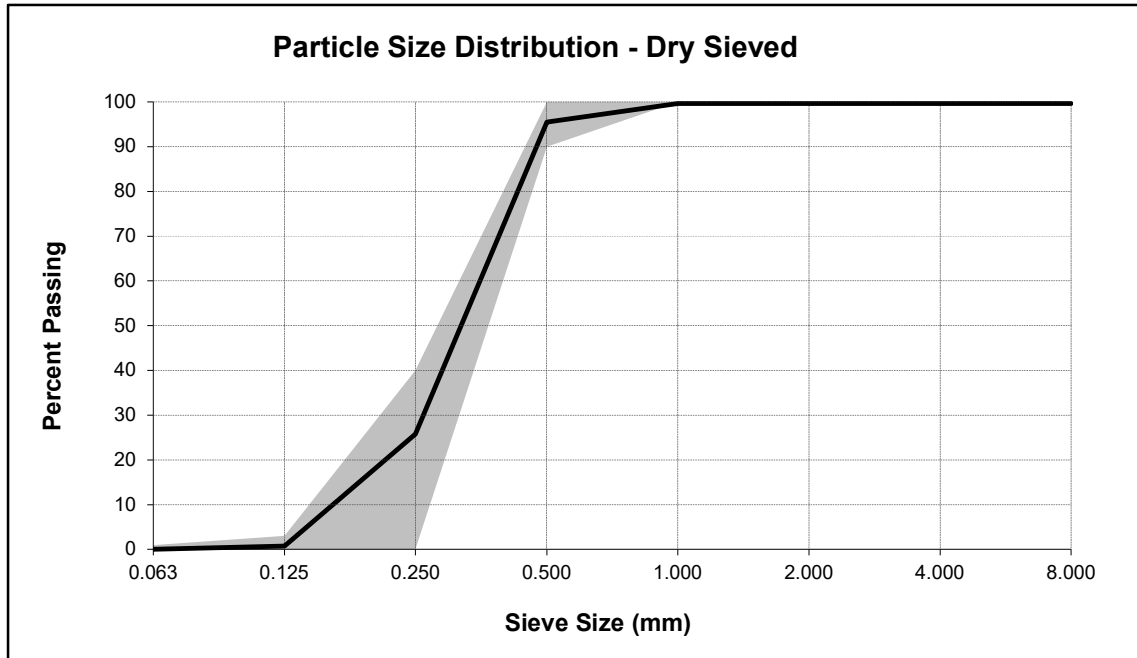

Checked by:

B. Hannan
Brendan Hannan

Date:

28 July 2021

